

Transmitter PM34
Intelligent pressure transmitter with
flush mounted diaphragm

Process coupling: thread, sanitary, clamp
From 100 mbar up to 400 bar
Self monitoring
Local display and adjustment
Multiple overload
Explosion protection ATEX 100
Analogue, Smart - or Profibus-pA function

## **PROFILE**

The transmitter measures gauge- and absolute pressure in gases, vapours and liquids and can be used in nearly all areas of process engineering.

The transmitter works on the two-wire principle and features a polysiliconmeasuring element. Gauge and absolute pressures from 100 mbar up to 400 bar respectively, are converted into a standard pressure proportional 4...20 mA signal. With the smart version remote operation is possible by means of HART protocol. The BUS version uses digital communication for signal output. The digital version can be equipped with a local display comprising digital display and bargraph whereas the analogue version allows only a bargraph display. The applied technology ensures reliable and simple operation.

# **DESCRIPTION**

The transmitter comprises the measuring cell, the process coupling and the electronics housing. The connecting terminals are accessible in a separate compartment after opening the lid.

The process pressure acts onto a metallic isolating diaphragm. Via the filling media (vegetable or mineral oil) the pressure is transferred to the Polysilicon-sensor with the piezo-resistive bridge. The output signal of the bridge is being processed. According to the process requirements is the isolating diaphragm flush mounted.

The analogue-electronic is an economic, fast and simple version. Zero and span can be adjusted locally by means of two potentiometers. With dip switches coarse setting of span with a spread of 1:1 up to 10:1 is possible. The required pressure signals must be provided as reference.

The analogue electronics features within the cell limits adjustment of Zero with  $\pm$  10 %.

Digital-electronics provides widespread operating and adjustment facilities with the corresponding hand-held terminal or via PC engineering. It realises precise signal processing and monitors the transmitter function from sensor to output function. Local operation is performed by means of push buttons and the pluggable display. The required pressure signals must be provided as reference and will be stored via push button operation.

Based upon the used measuring cell a turn down of 10:1 is possible.

The transmitter monitoring function generates an alarm if any fault is being detected. The alarm acts onto the analogue output signal and can be set in its function.

## **TECHNICAL DATA**

#### **INPUT**

Absolute and gauge pressure in gases, vapours, liquids.

Polisilicon cell for ranges up to 400 bar

## **GAUGE PRESSURE**

| Cell |       | Measuring limits | Min. Span | Overload |
|------|-------|------------------|-----------|----------|
| Type | [bar] | [bar]            | [bar]     | [bar]    |
| 3H   | 1     | 01               | 0,1       | 4        |
| 3M   | 4     | 04               | 0,4       | 16       |
| 3P   | 10    | 010              | 1         | 40       |
| 3S   | 40*   | 040              | 4         | 160      |
| 3U   | 100*  | 0100             | 10        | 400      |
| 3Z   | 400*  | 0400             | 40        | 600      |
| 7H   | ± 1   | -1+1             | 0,2       | 4        |
| 7M   | -14   | -1+4             | 0,5       | 16       |
| 7P   | -110  | -1+10            | 1,0       | 40       |

<sup>\*)</sup>Absolute pressure sensors

#### ABSOLUTE PRESSURE


| Cell       |     | Measuring limits | Min. Span | Overload |
|------------|-----|------------------|-----------|----------|
| Type [bar] |     | [bar]            | [bar]     | [bar]    |
| 4H         | 1   | 01               | 0,1       | 4        |
| 4M         | 4   | 04               | 0,4       | 16       |
| 4P         | 10  | 010              | 1         | 40       |
| 4S         | 40  | 040              | 4         | 160      |
| 4U         | 100 | 0100             | 10        | 400      |
| 4Z         | 400 | 0400             | 40        | 600      |

**Minimum pressure:** 10 mbar absolute

#### **PROCESSMEDIA**

Liquids, gases, vapour (abrasive, aggressive or corrosive with suitable material).

Fig. 1 Versions



## **WETTED MATERIALS**

## Diaphragm

Stainless Steel SS 316 L (1.4435)

## Process coupling

Stainless Steel SS 316 L (1.4435)

## **PROCESS CONDITIONS**

Process temperature -40.... +125 °C (150 °C duration max 1 h)

## **OUTPUT**


|   | Analogue                             | Smart  |  |  |
|---|--------------------------------------|--|--|--|
| Signal  | 420 mA                               | 420 mA, with superimposed communication protocol   |  |  |
| Signal on alarm   | > 20.5 mA or<br>< 3.6 mA<br>settable | settable to > 20.5 mA or < 3.6 mA or HOLD  |  |  |
| Ripple  |                                      | (HART), measured on 500 $\Omega$ 47125 Hz U <sub>PP</sub> =200 mV, Noise: 500 Hz up to 10 kHz U <sub>RMS</sub> 2.2 mV (on 500 $\Omega$ ) |  |  |
| Characteristic  | Pressure proprtional                 |  |  |  |
| Conformity error incl. hysterisis and reproducibility, (limit point method) | ± 0.3 %                              |  |  |  |
| Integration time (settable)   | 0s, 2 s                              | 0s, 2s, via HART 040 s   |  |  |
| Rise time   | 60 ms                                | 220 ms   |  |  |
| D .:  | 180 ms                               | 600 ms   |  |  |
| Response time   |                                      |  |  |  |
| Warm-up time  | 200 ms                               | 1 s  |  |  |

Output BUS: Profibus PA

# MAX. LOAD

$$R_{Load} = \frac{U_{Supply} - 11.5[V]}{0.023[V]} - R_{Lead}[\Omega]$$

Fig. 2 Dimensions

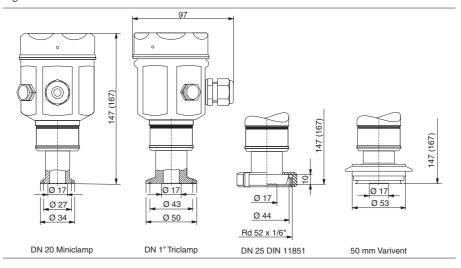

## **DISPLAY**

Fig. 3 Display, smart version



# **OPERATION**

| Analogue | Adjustment of zero and span via DIP switches and two potentiometer direct. Selection of damping.                                 |
|----------|--|
| Smart    | Adjustment of zero and span by means of two<br>push buttons direct. Setting of damping. Remote<br>operation via HART protocol    |
| BUS      | Adjustment of zero and span by means of two<br>push buttons direct. Setting of address.<br>Remote operation via digital protocol |

## SUPPLY

## **DIRECT CURRENT**

11.5 ... 45 VDC

11.5 ... 30 VDC with EEx

## Ripple of supply voltage

No effect for  $U_{RMS} \le \pm 5$  % within permissible range

## Overvoltage category

II to DIN EN 61 010-1

## **EXPLOSION PROTECTION**

Mode: ATEX 100, II 1 / 2 G, EEx ia IIC T6


## Certificate of conformity


No. applied for


#### Mounting


Transmitter in hazarded area zone 1


Fig. 4 Metal conical seal and welded nozzle











# **ENVIRONMENTAL CONDITIONS**

# PERMISSIBLE TEMPERATURES

For operation:  $-40... + 85 \,^{\circ}\text{C}$ For storage:  $-40.... + 100 \,^{\circ}\text{C}$  (with display  $+85 \,^{\circ}\text{C}$ )

**Temperature effect**  $T_K^*$ ) for span start and span (Referred to nominal value of cell)

| Analogue     |                      | Smart        |                      |
|--------------|----------------------|--------------|----------------------|
| -10+60 °C    | -4010 <<br>>+6085 °C | -10+60°C     | -4010 <<br>>+6085 °C |
| ± 0.15%/10 K | ± 0.2 %/10 K         | ± 0.08%/10 K | ± 0.1%/10 K          |

<sup>\*)</sup> But not exceeding error due to thermal effects.

#### Thermal effect

Referred to set span

 $\pm (X\% \times TD + 0.3\%)$ 

(TD = nominal value/set span)

| Analogue |                  | Smart     |                  |
|----------|------------------|-----------|------------------|
| -10+60°C | -4010 < >+6085°C | -10+60 °C | -4010 < >+6085°C |
| X = 0.3  | X = 0.5          | X = 0.2   | X = 0.4          |

#### Climatic class

4K4H to DIN EN 60721-3

#### **Vibrations**

No effects with 4 mm stroke at 5...15 Hz, or

2g at  $15...150~Hz,\,or\,1~g$  at 150...2000~Hz

# ELECTROMAGNETIC COMPATIBILITY

Complies with EN 50 081-1 and EN 50 082-2 as also NAMUR recommendation NE21: effect < 0.5 %

#### **GENERAL**

## **ELECTRONIC HOUSING**

stainless steel SS304 (no. 1.4301) Cover seal: Silicone rubber Type label: engraved with LASER in housing

## **MODE OF PROTECTION**

IP 66 / Nema 4 with cable gland IP 68 / Nema 6P with fixed cable (1m WG for 24 h, respectively 1.8 m WG for 30 minutes).

# **ELECTRICAL CONNECTION**Screw terminals for 0.5...2.5 mm<sup>2</sup>.

selectable via
Cable gland M 20 x 1.5
Cable conduit for ½ NPT
or
Harting plug HAN 7
or
Fixed cable 5m with reference air feed
Profibus is connected via M12x1 plug

## INSTALLATION CONDITIONS

Orientation as required, orientation-dependent zero shifts up to 3 mbar can be adjusted.


#### **WEIGHT**

approximately 1.1 kg

## **ACCESSORY**

Analogue electronics 9499-040-64511 Smart-electronics 9499-040-64311

Fig. 8 connection Harting plug



# **OPTIONAL ACCESSORIES**

Welding nozzle G1A


9407-290-00061

Dummy sensor to prevent any distortion during welding of nozzle

9407-290-00071

PM34 3

## **ORDERING STRUCTURE**

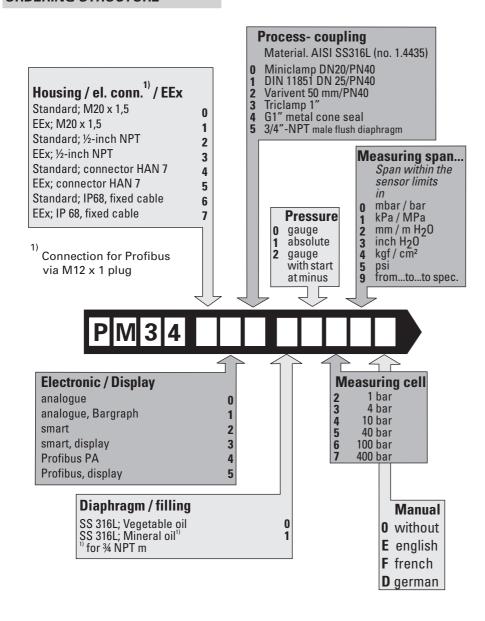



#### **Deutschland**

PMA Prozeß- und Maschinen- Automation GmbH Miramstraße 87, D-34123 Kassel

Tel./Fax: (0561) 505 - 1307/-1710 E-mail: mailbox@pma-online.de Internet: http://www.pma-online.de Your local distributor